

1/19

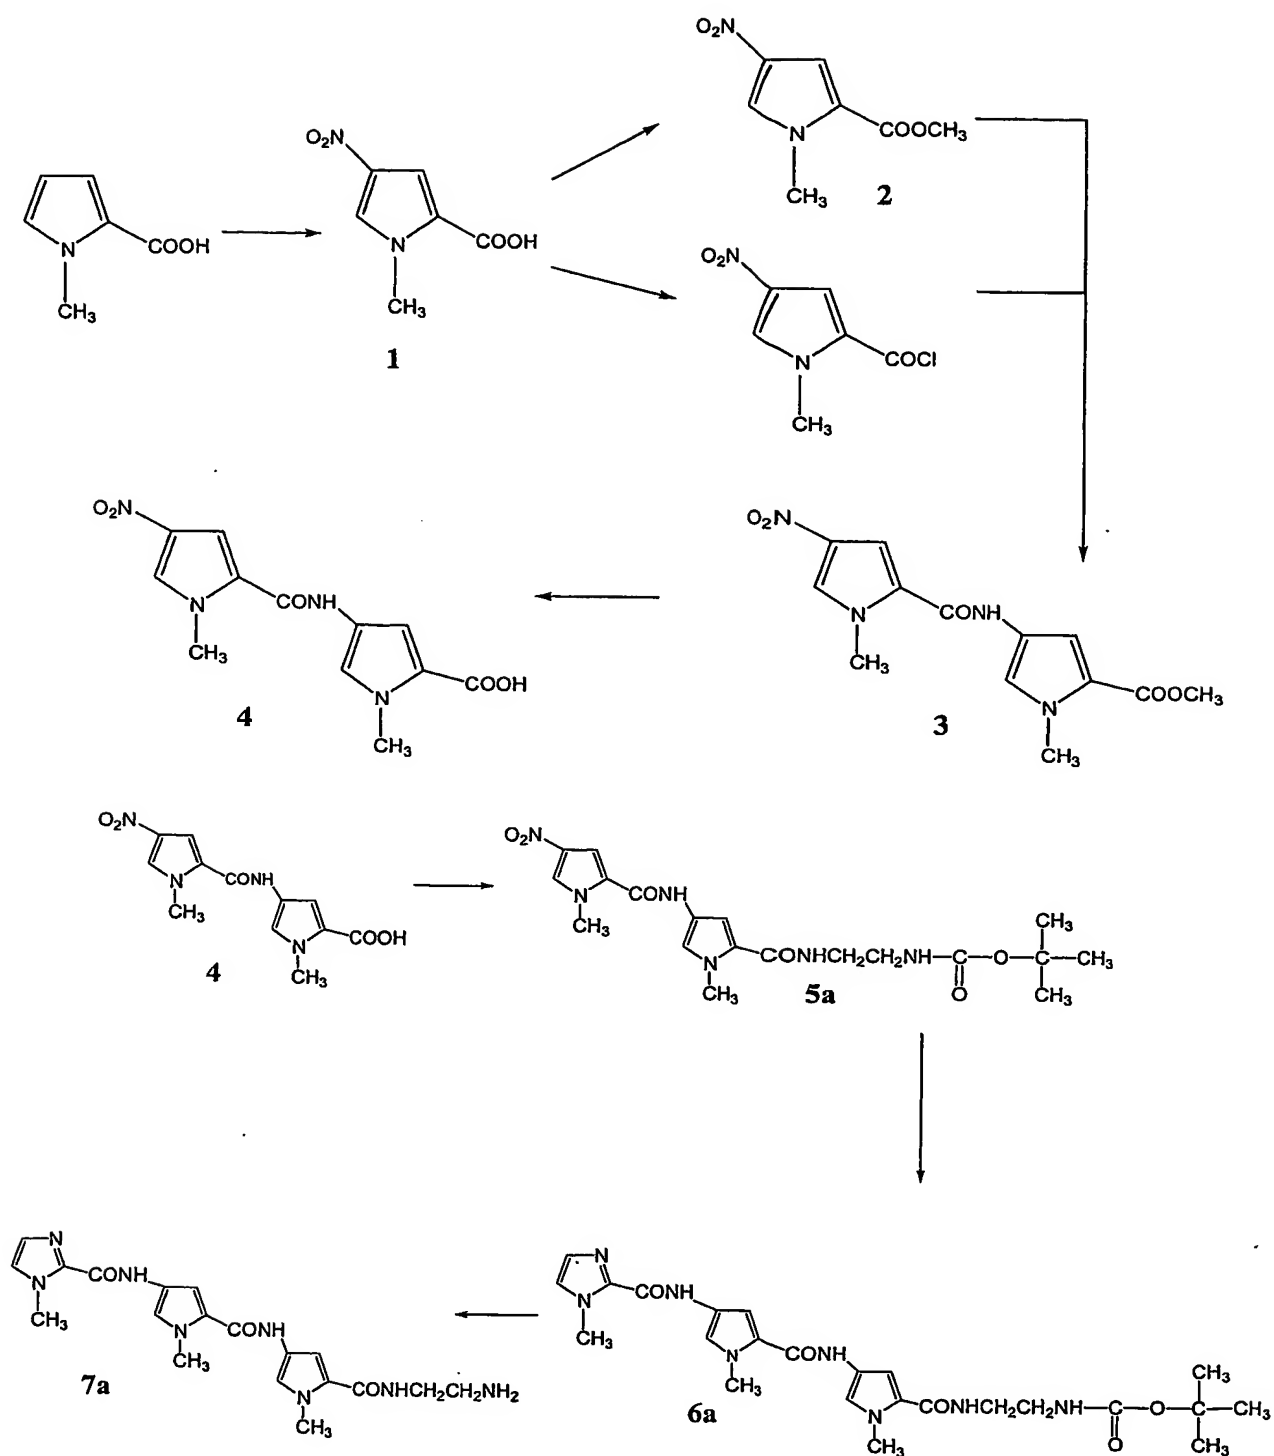


Figure 1

2/19

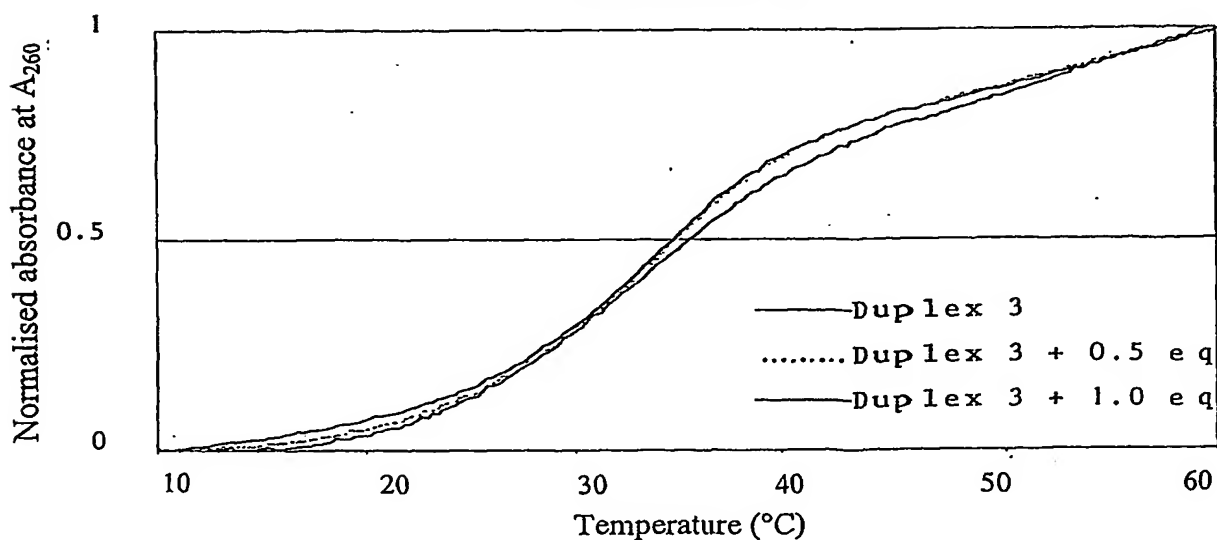
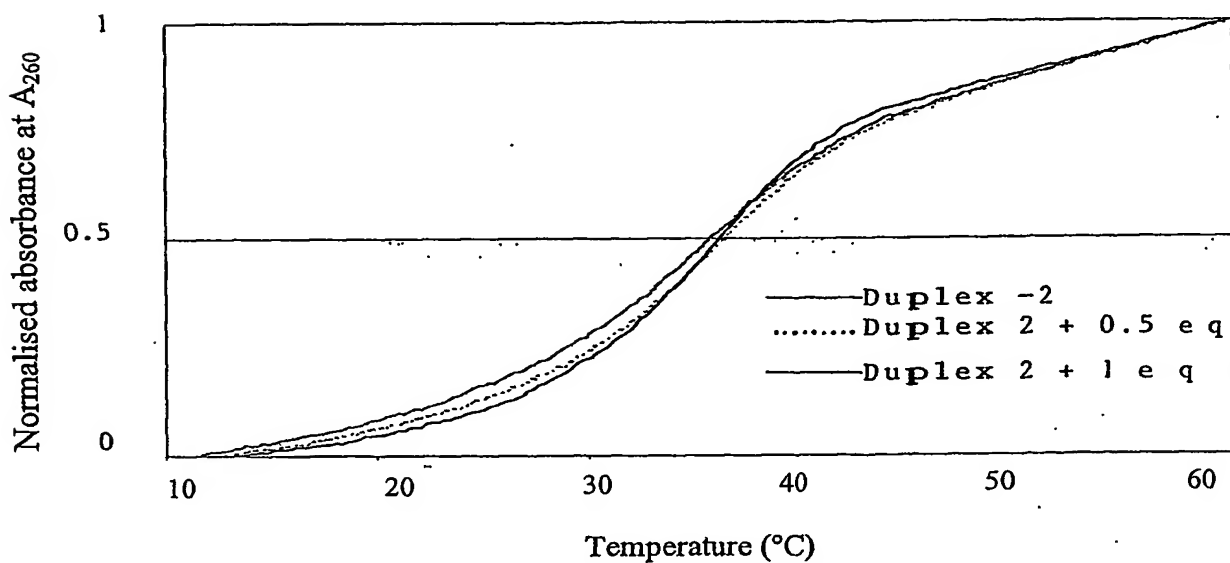
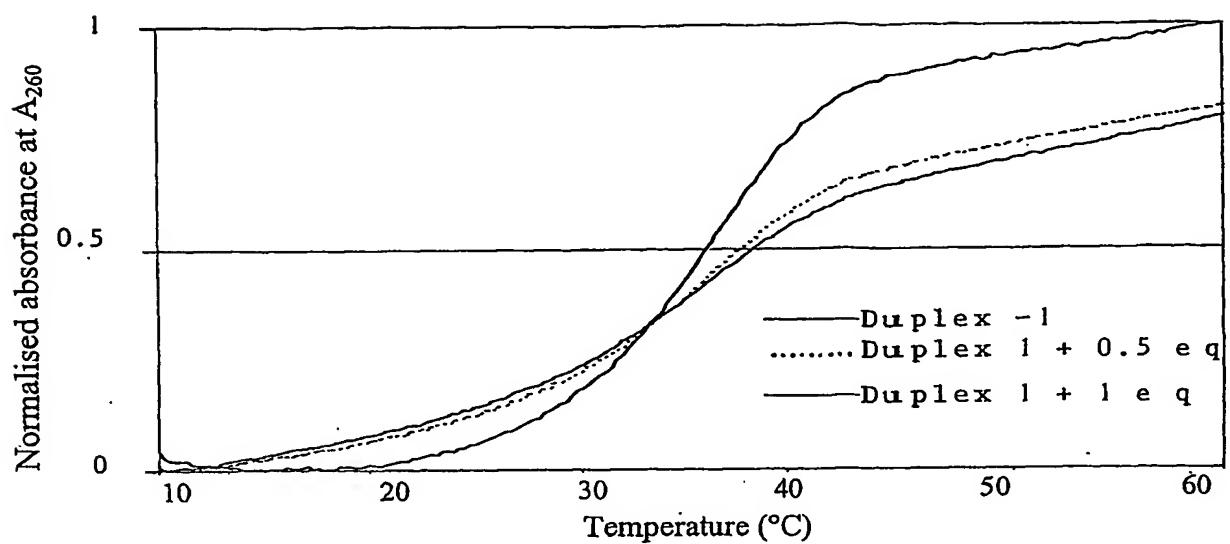


Figure 2

## CD titration Spectra

## ICD titration Spectra

DJ1953-2 trans-lm/Py/Py-[CONH(CH<sub>2</sub>)<sub>2</sub>-NH<sub>2</sub>)<sub>2</sub>-Pt(NH<sub>3</sub>)<sub>2</sub>Cl

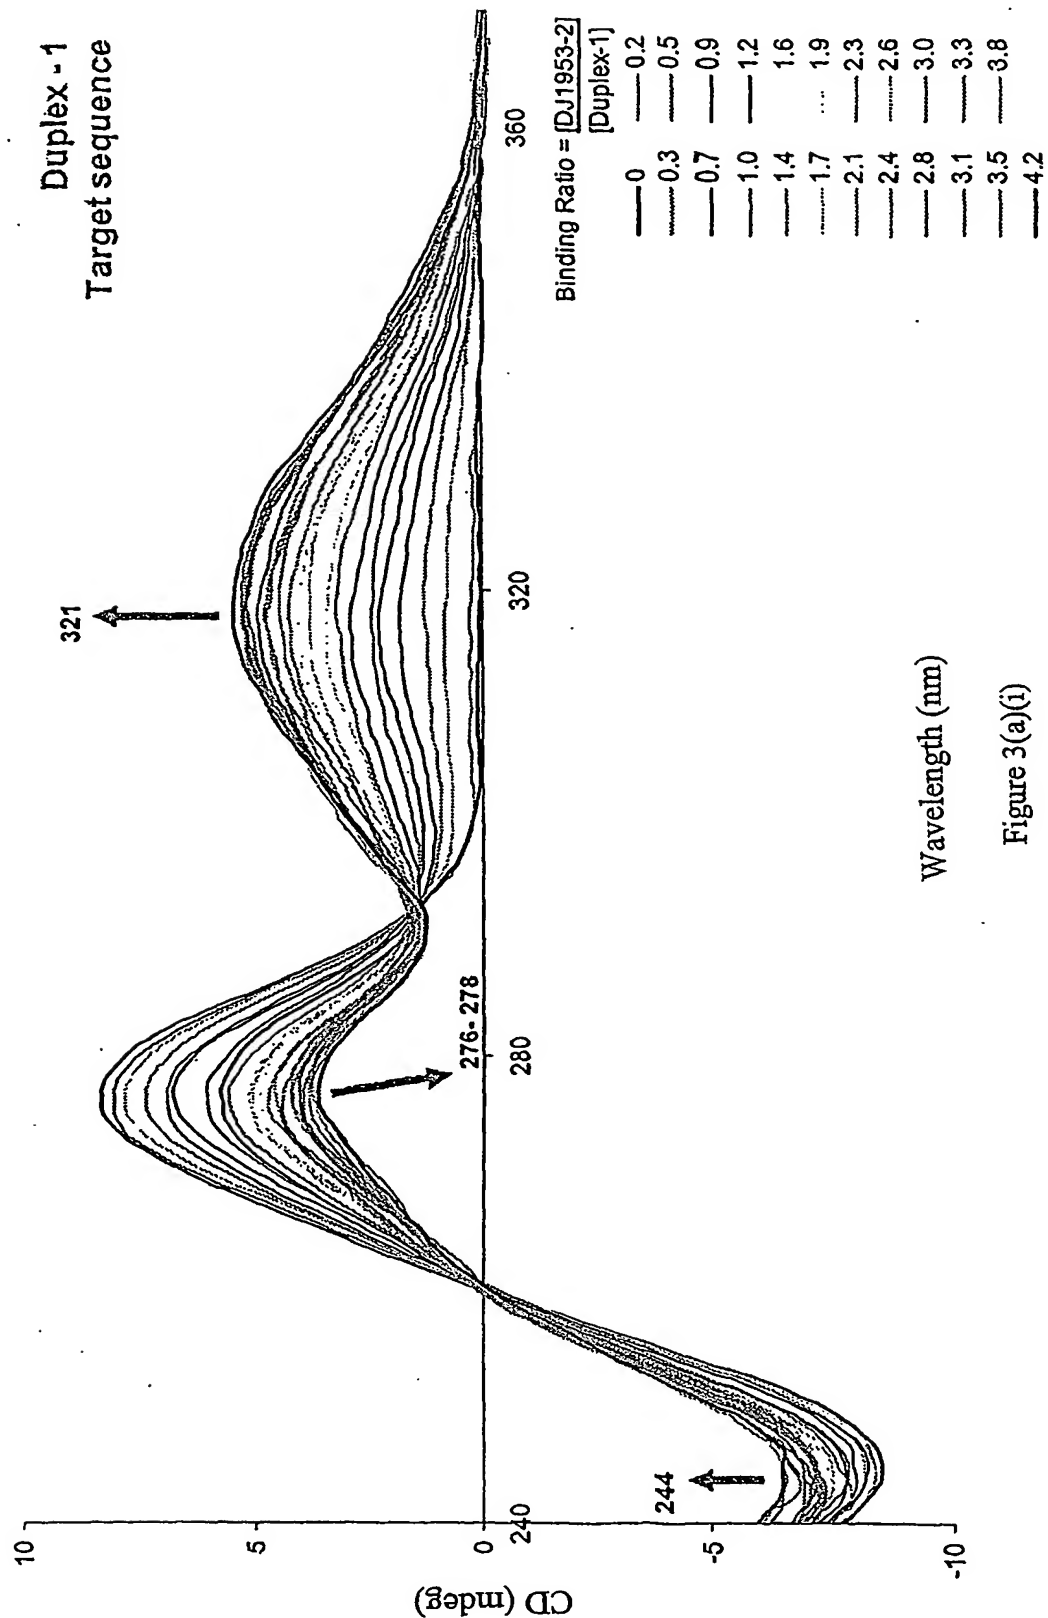


Figure 3(a)(i)

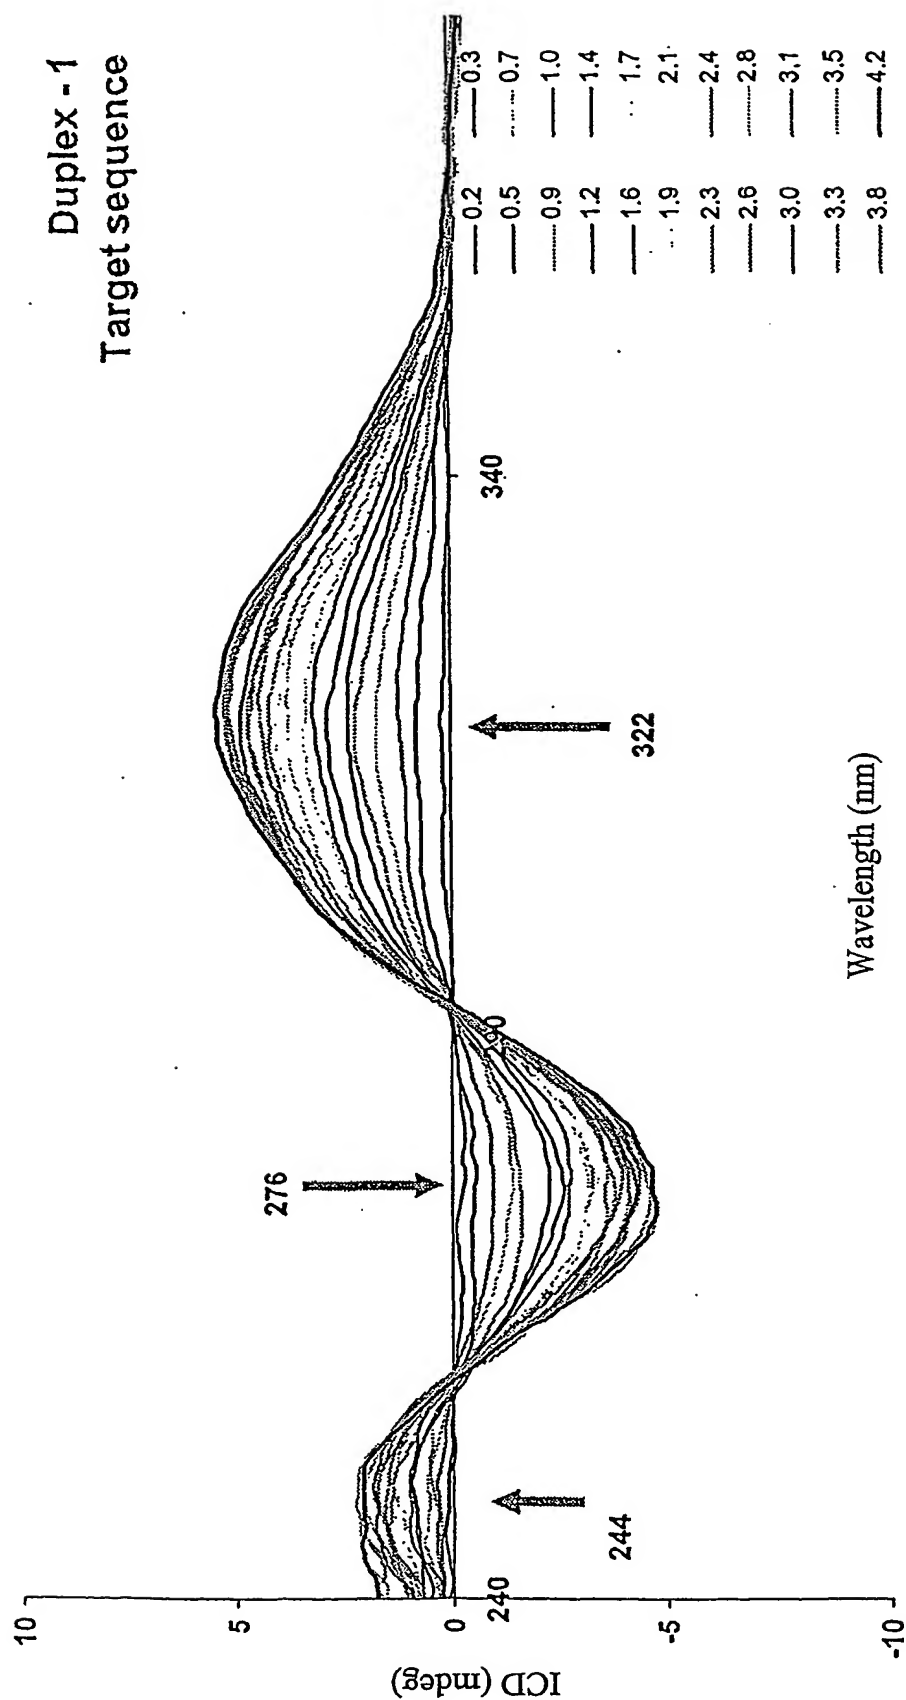


Figure 3(a)(ii)

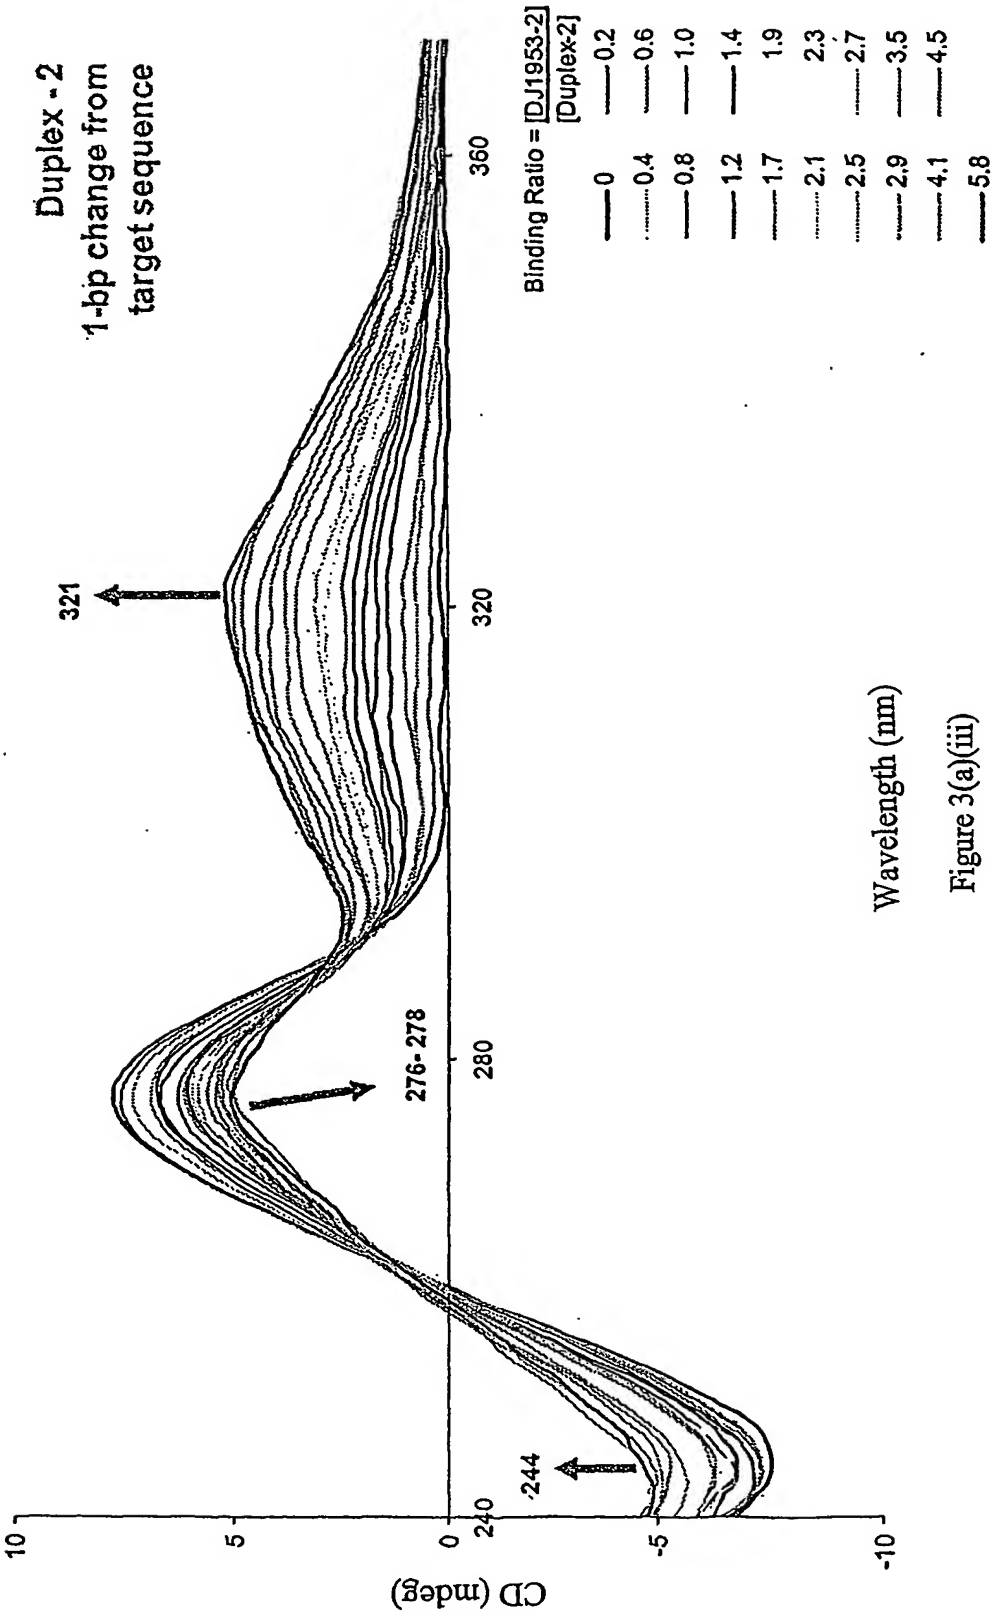
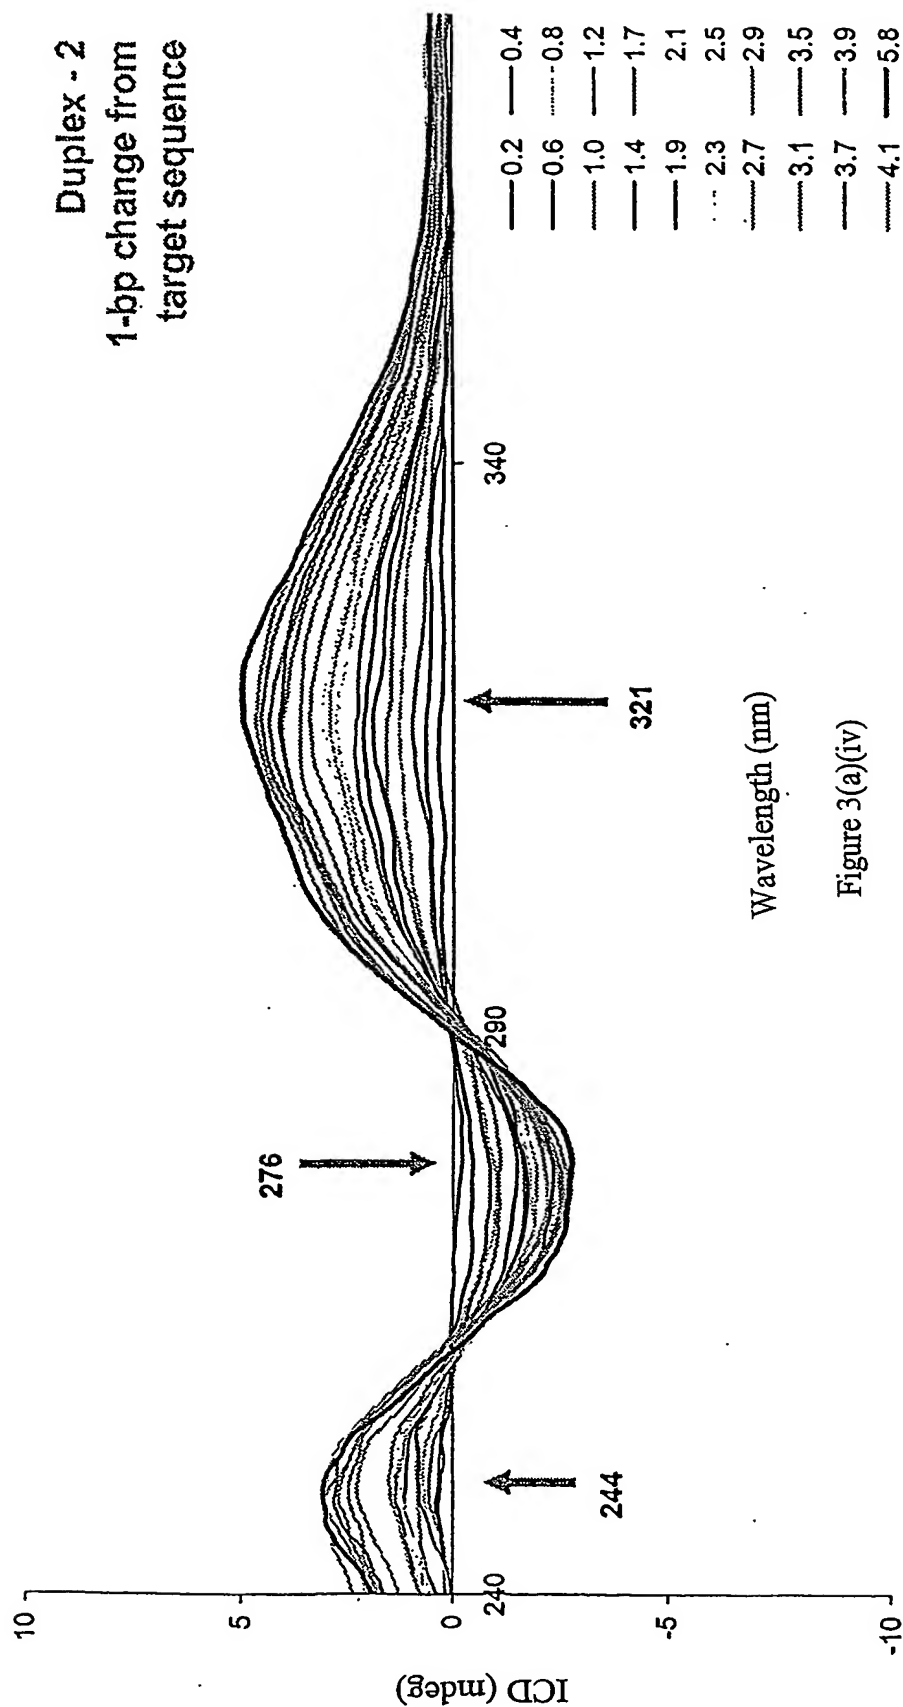


Figure 3(a)(iii)

6/19




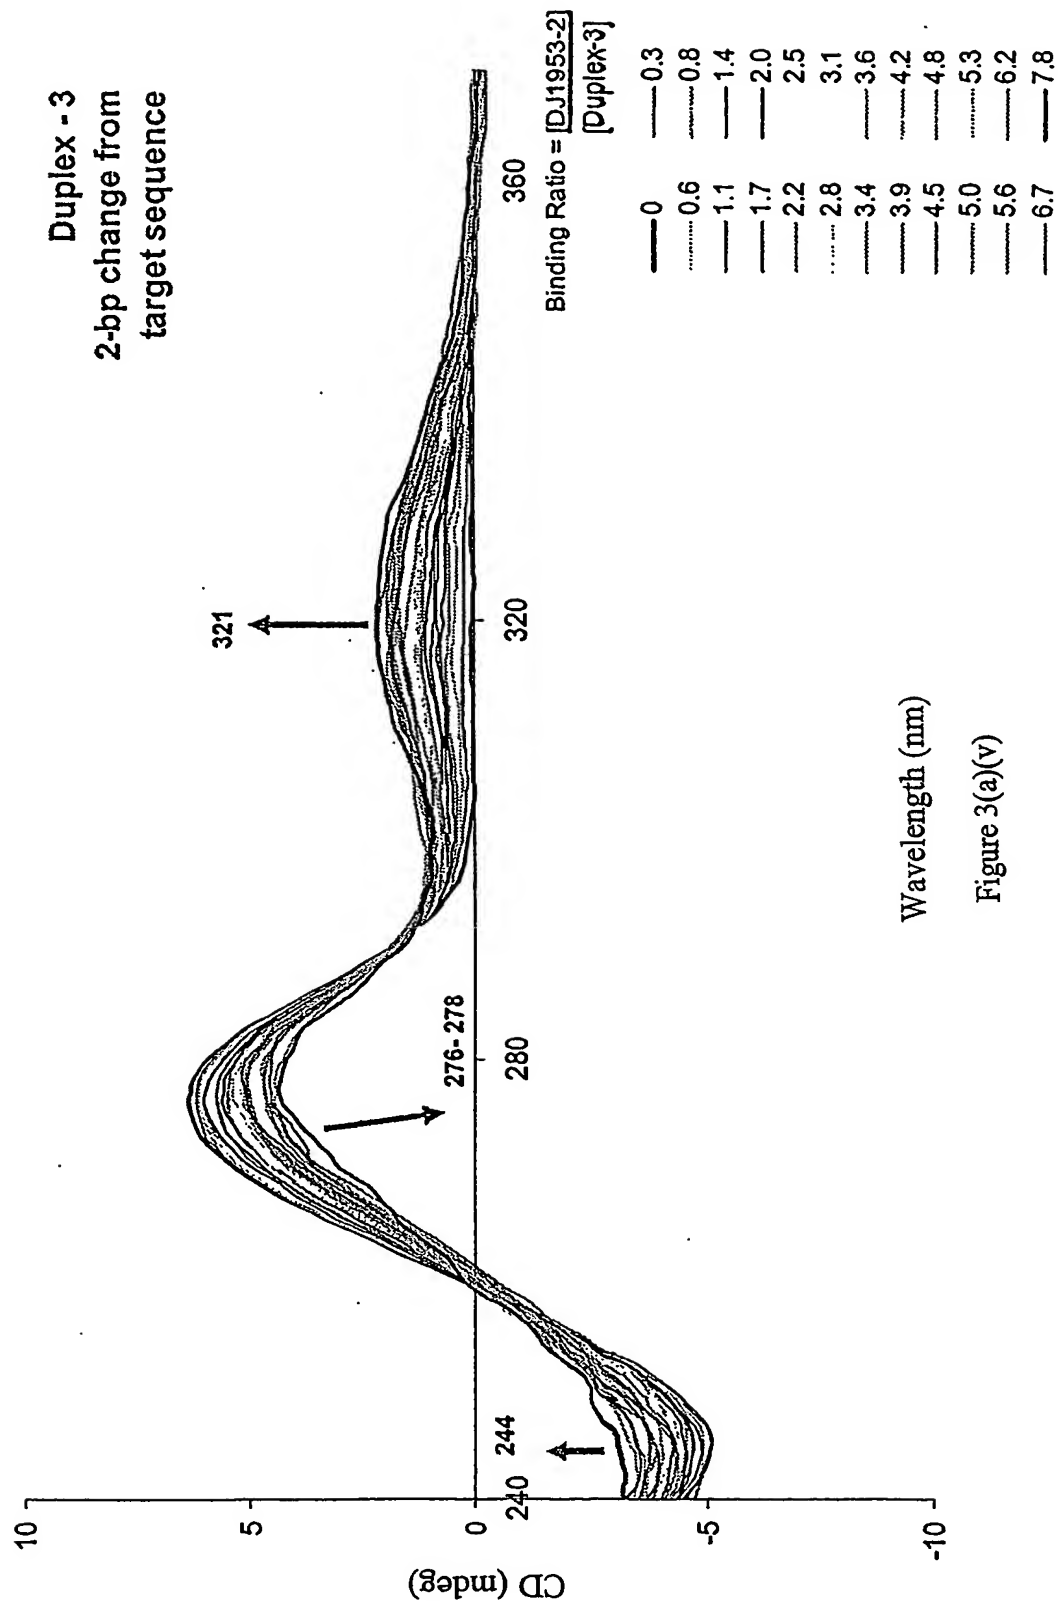


Figure 3(a)(v)



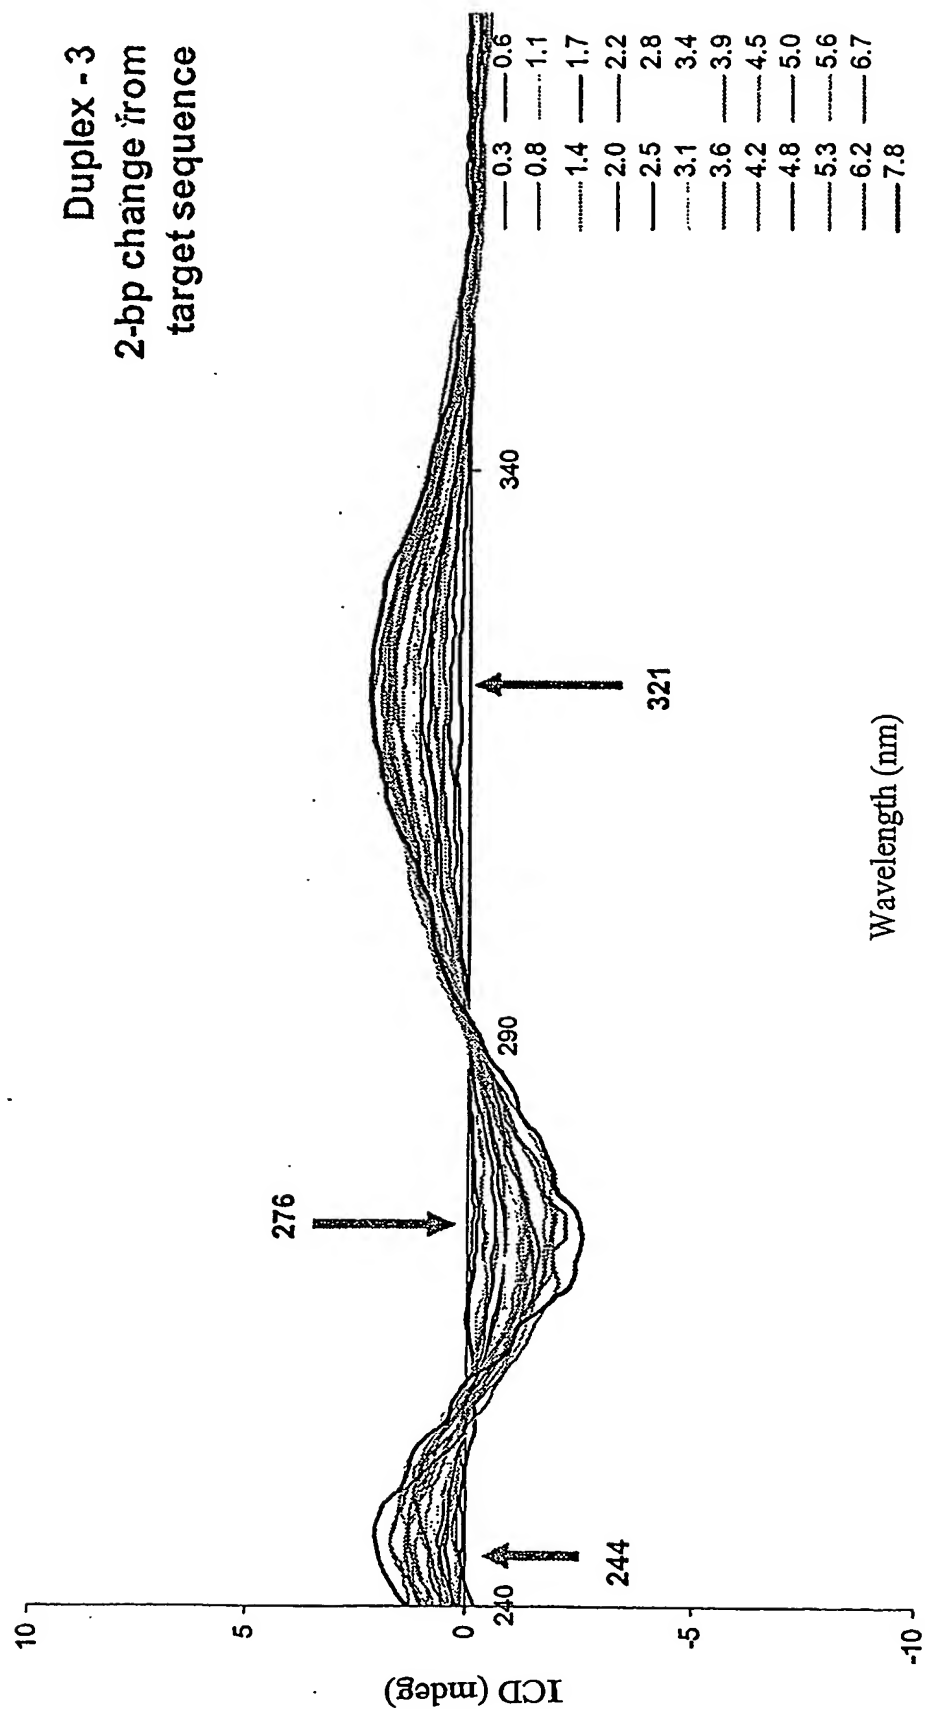

9/19

trans-Im/Py/Py-[CONH(CH<sub>2</sub>)<sub>6</sub>-NH<sub>2</sub>)Pt(NH<sub>3</sub>)<sub>2</sub>Cl

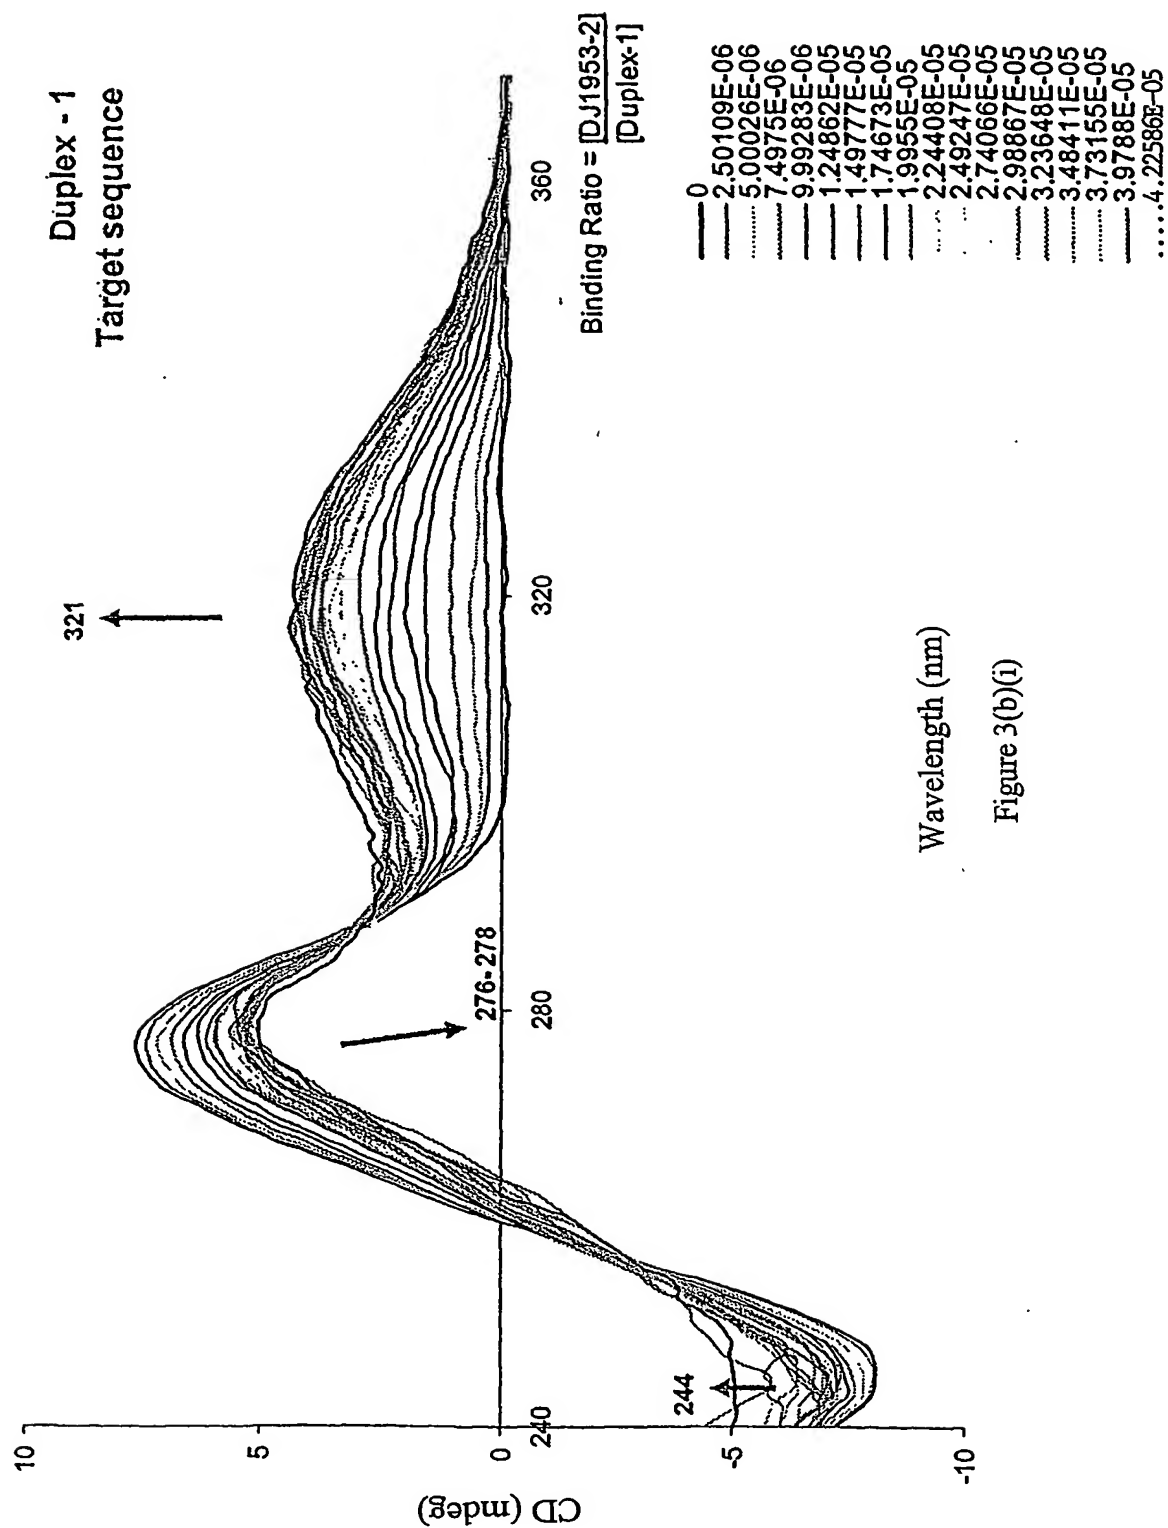


Figure 3(b)(i)

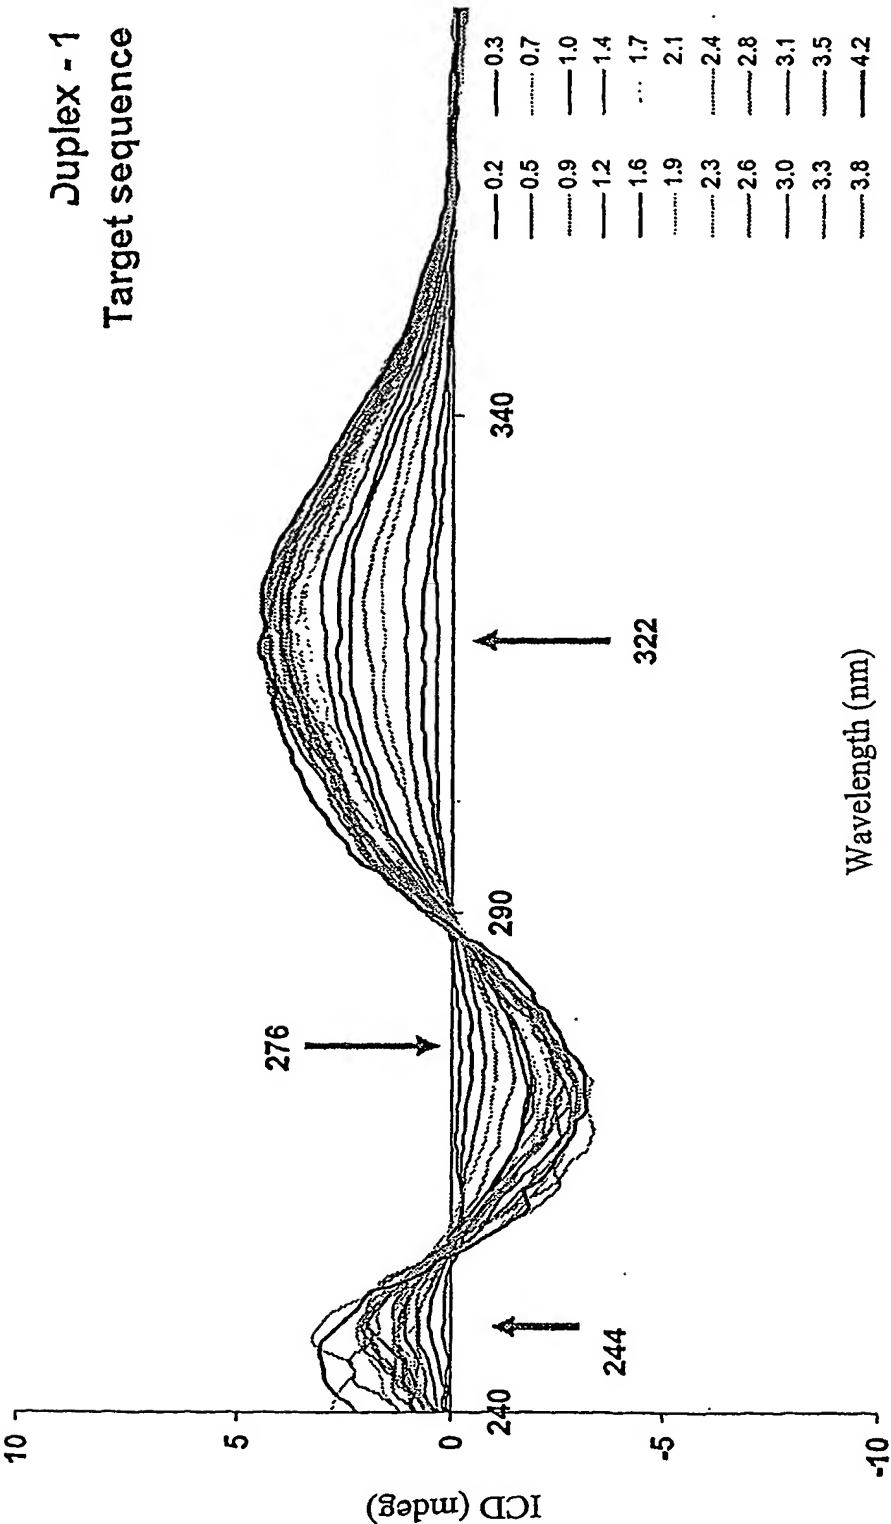


Figure 3(b)(ii)


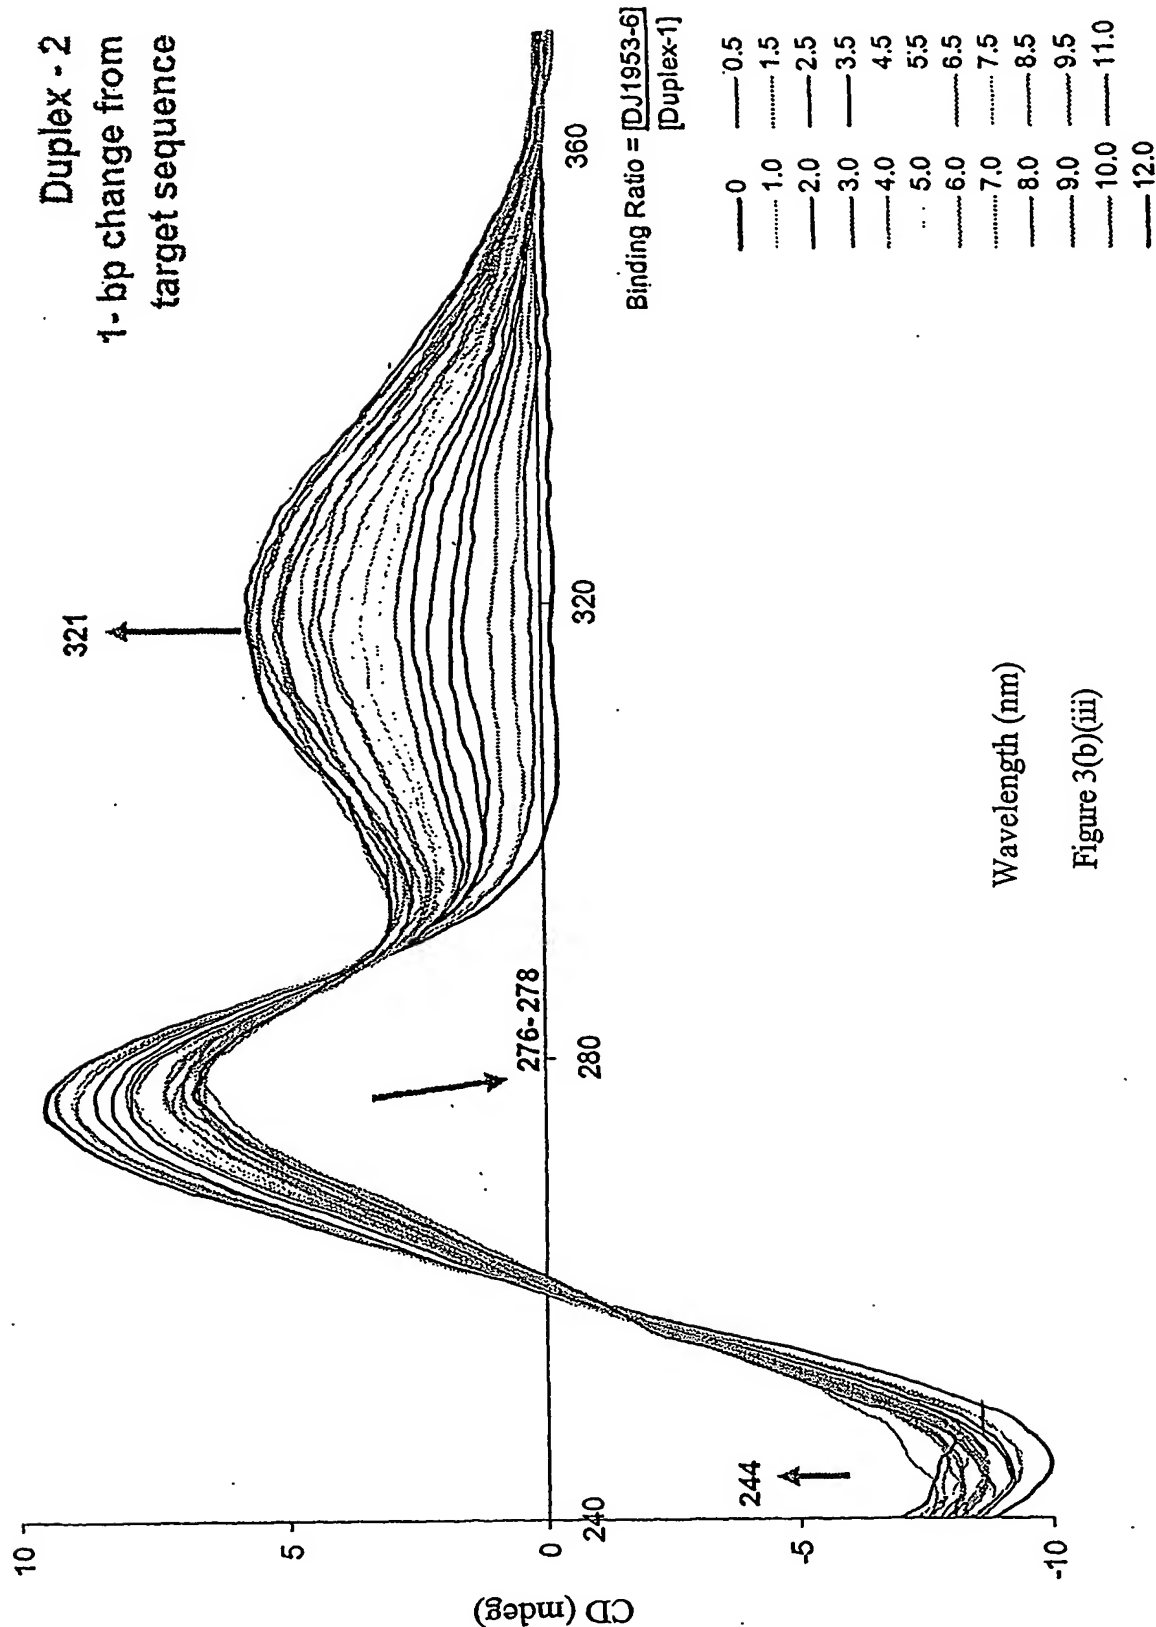


Figure 3(b)(iii)

Duplex - 2  
1-bp change from  
target sequence

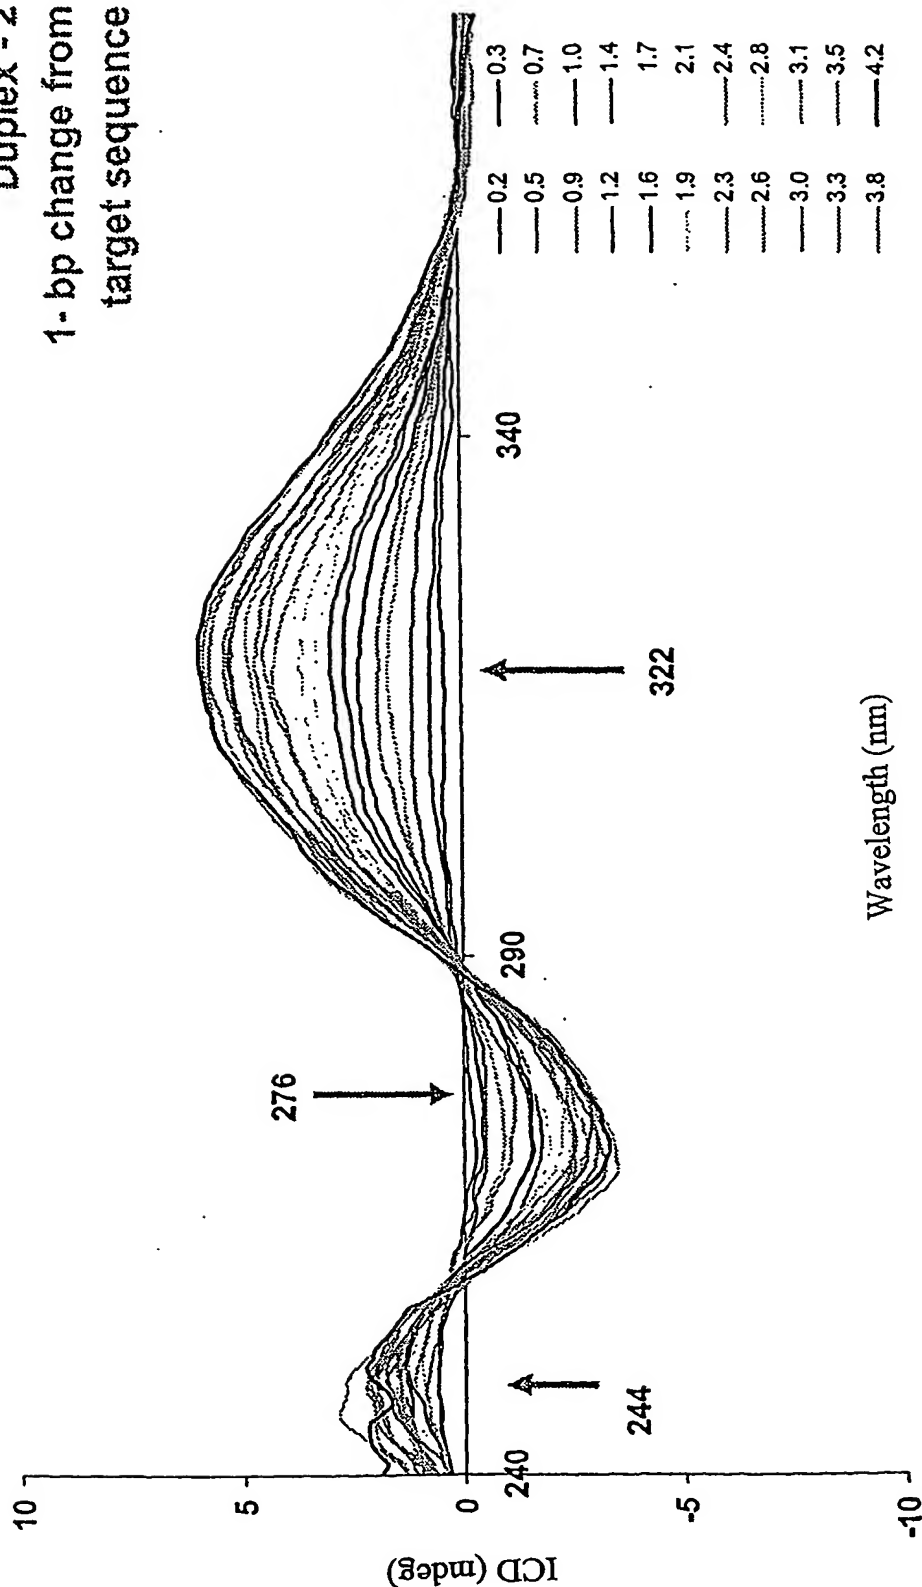

Wavelength (nm)

Figure 3(b)(iv)

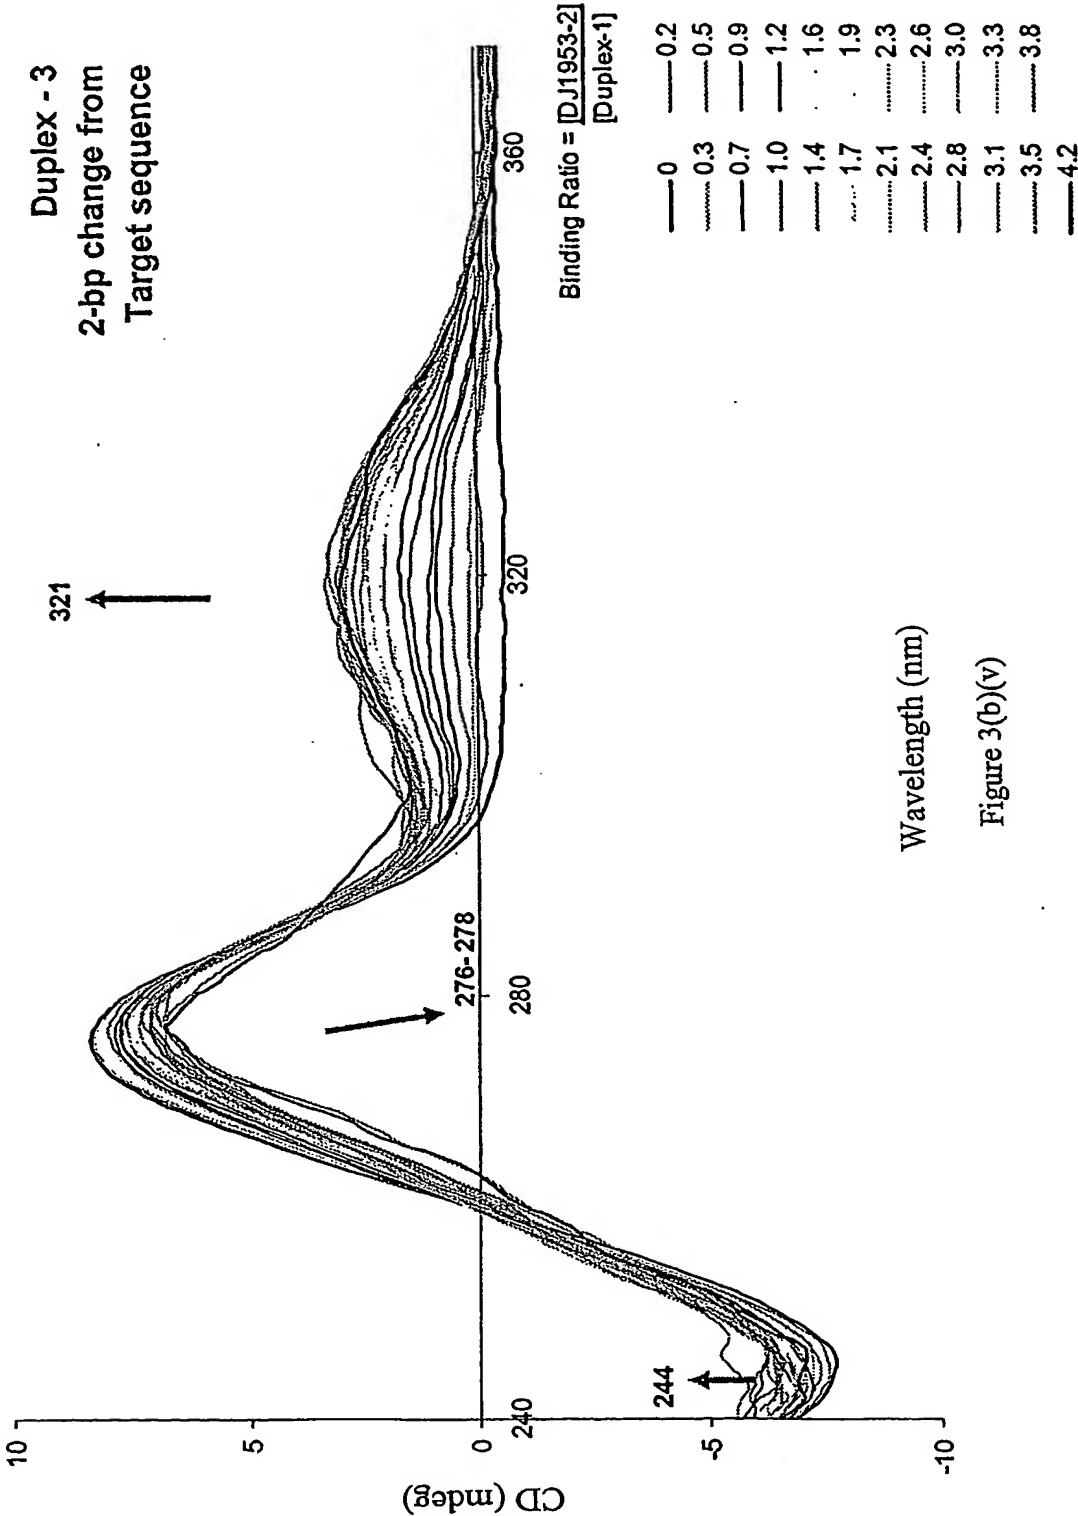


Figure 3(b)(v)



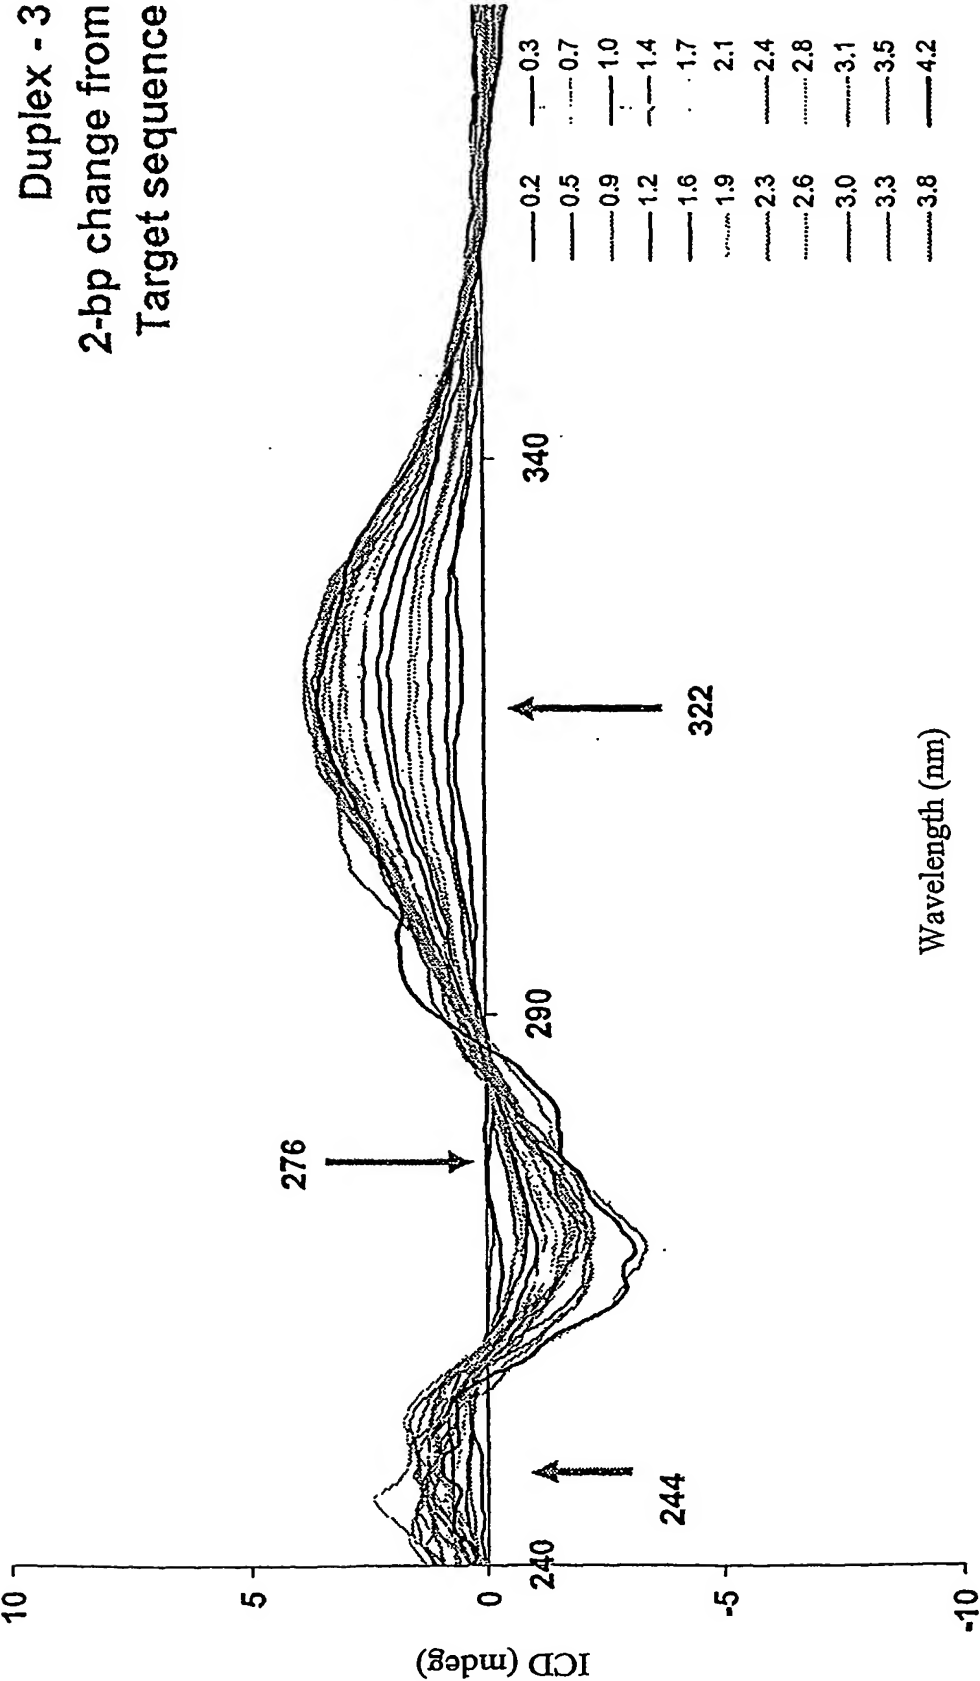



Figure 3(b)(vi)

**Figure 3c**

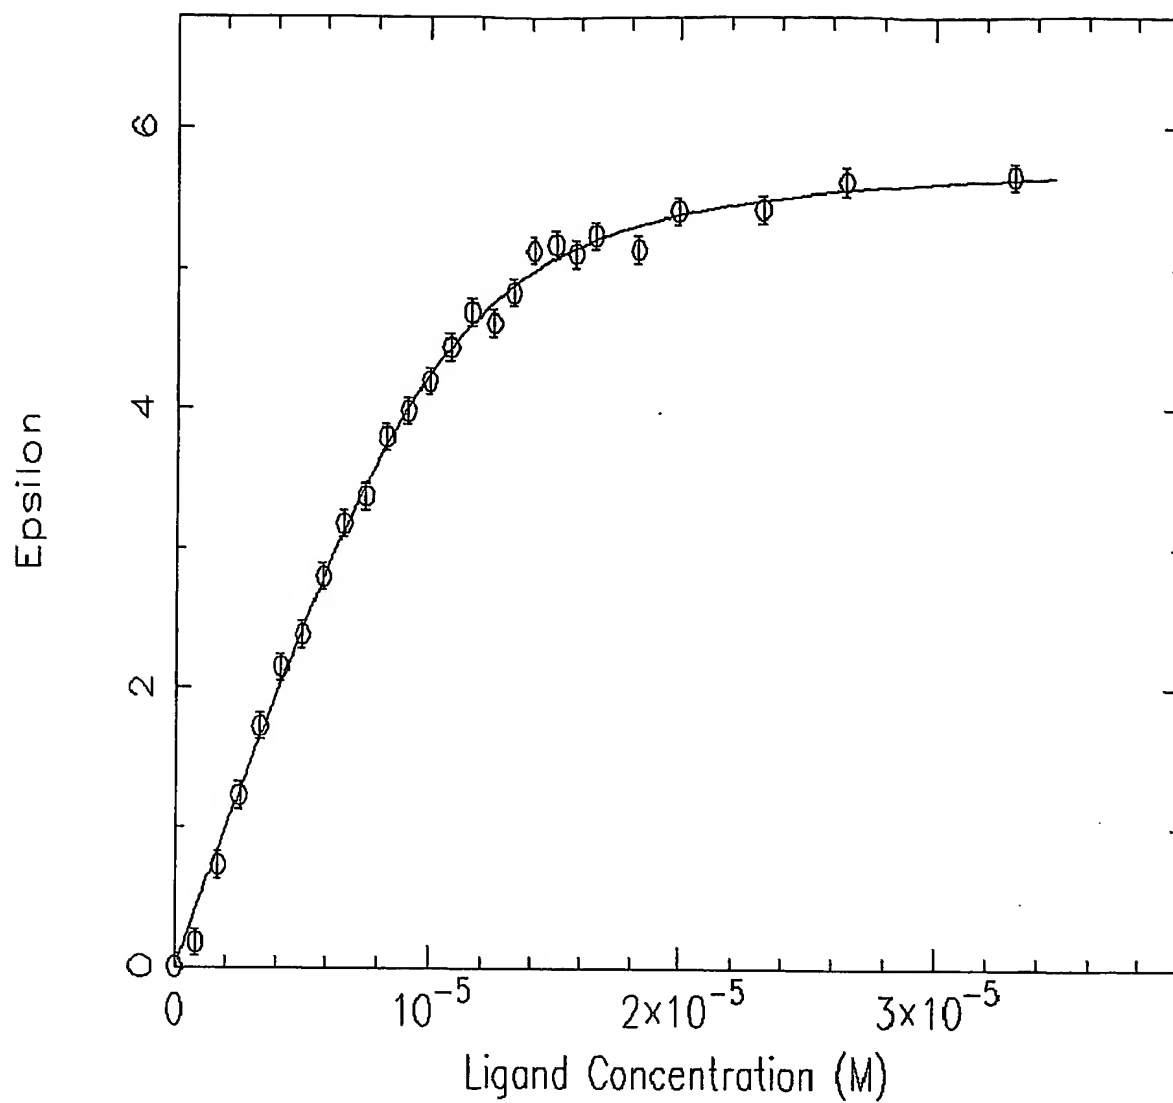

**Figure 4**

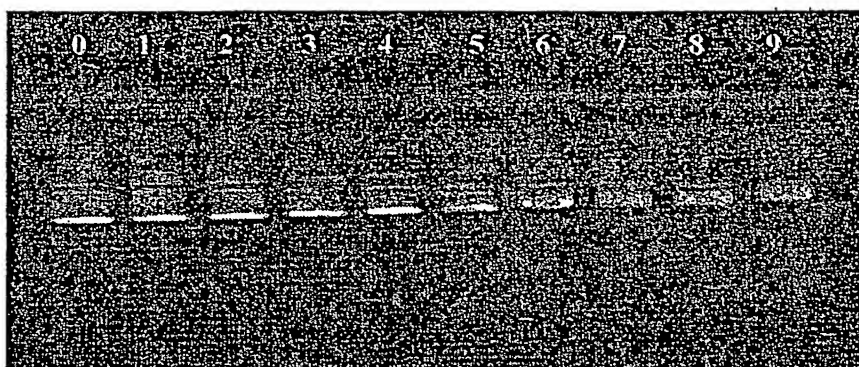

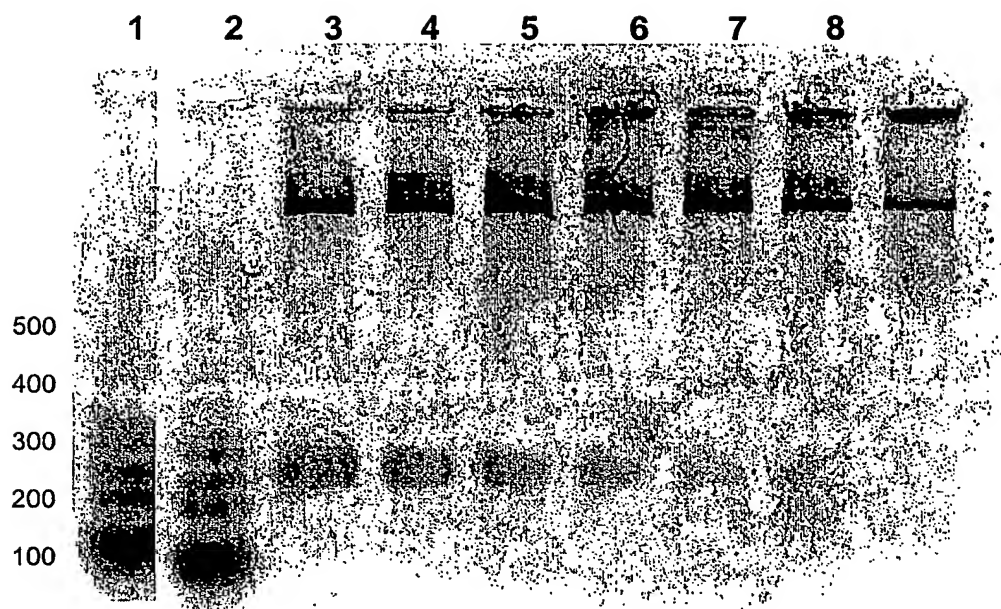**Figure 5**

18/19

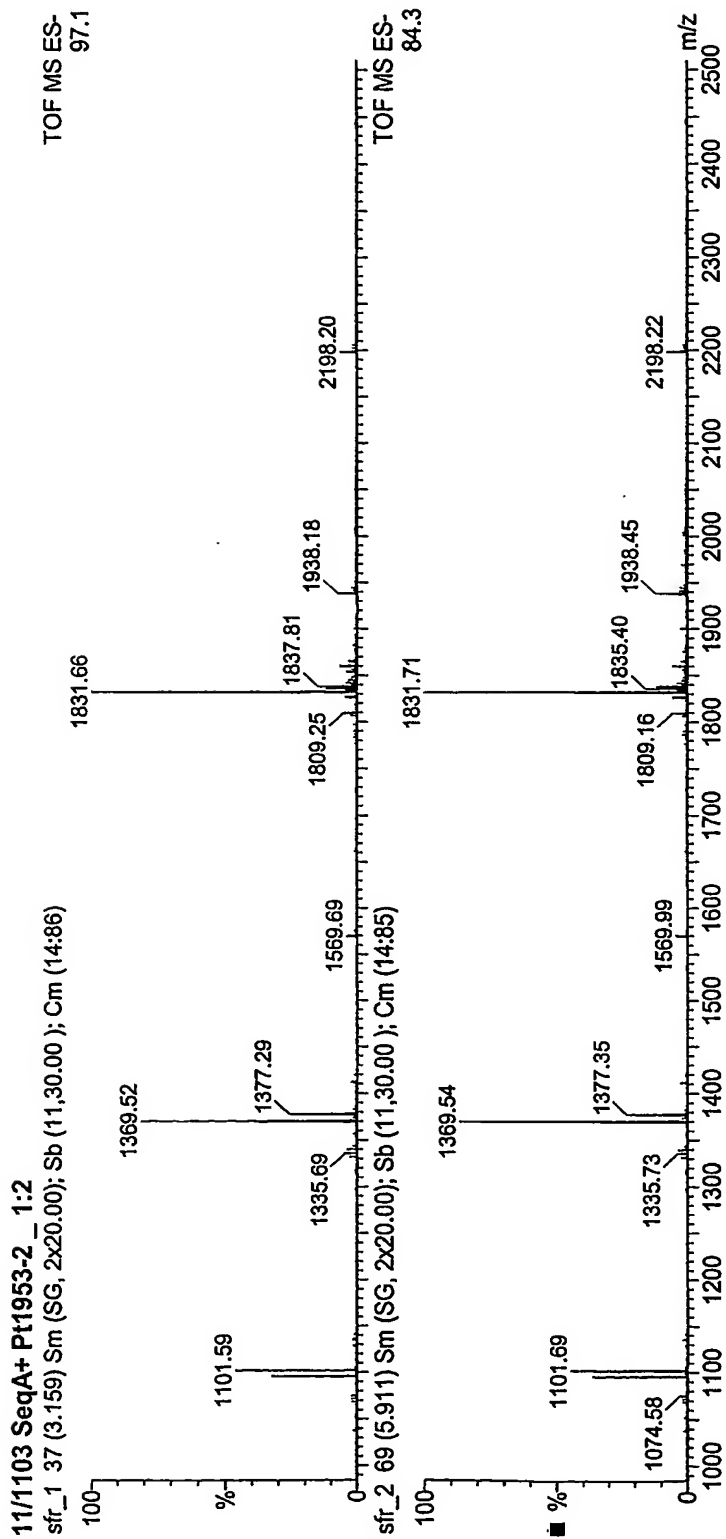


Figure 6

19/19

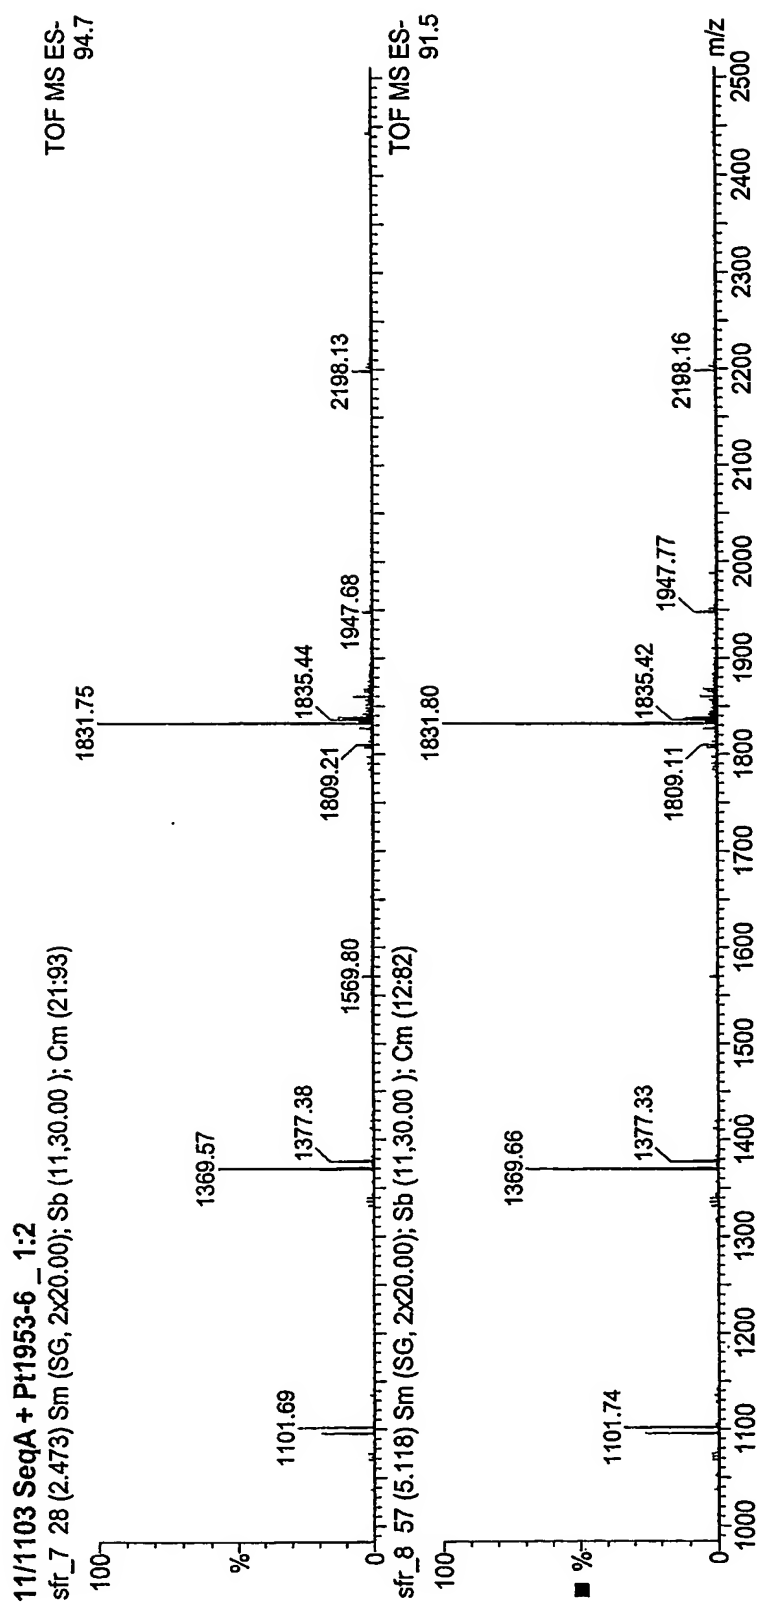


Figure 7

**This Page is Inserted by IFW Indexing and Scanning  
Operations and is not part of the Official Record**

**BEST AVAILABLE IMAGES**

Defective images within this document are accurate representations of the original documents submitted by the applicant.

Defects in the images include but are not limited to the items checked:

- ☐ BLACK BORDERS
- ☐ IMAGE CUT OFF AT TOP, BOTTOM OR SIDES
- ☐ FADED TEXT OR DRAWING
- ☐ BLURRED OR ILLEGIBLE TEXT OR DRAWING
- ☐ SKEWED/SLANTED IMAGES
- ☐ COLOR OR BLACK AND WHITE PHOTOGRAPHS
- ☐ GRAY SCALE DOCUMENTS
- ☒ LINES OR MARKS ON ORIGINAL DOCUMENT
- ☐ REFERENCE(S) OR EXHIBIT(S) SUBMITTED ARE POOR QUALITY
- ☐ OTHER: \_\_\_\_\_

**IMAGES ARE BEST AVAILABLE COPY.**

**As rescanning these documents will not correct the image problems checked, please do not report these problems to the IFW Image Problem Mailbox.**